


TYPICAL PLAN VIEW

NOTES:

1. METER SIZE & TYPE AS DETERMINED BY THE CITY.
2. CONTRACTOR SHALL BE RESPONSIBLE FOR ALL PIPING & VALVES AND SHALL PROVIDE BRONZE THREADED (FIP) COUPLINGS FOR METER CONNECTION.
3. METER MUST BE INSTALLED HORIZONTALLY.
4. ALL VALVES MUST BE VISIBLE, ACCESSIBLE, AND OPERATIONAL.
5. ALL INSTALLATIONS SHALL HAVE REMOTE RECEPTACLE LOCATIONS APPROVED BY THE CITY. SEE PLAN ABOVE FOR ACCEPTABLE LOCATIONS.
6. A FREE AND UNOBSTRUCTED PASSAGEWAY MUST BE PROVIDED AND MAINTAINED WITH NO PARTITION, NO FURNACE, NO WATER TANK, OR STORED MATERIAL WITHIN 500 mm OF THE METER.
7. ALL METERS INSTALLED BY CONTRACTOR MUST BE INSPECTED BY THE CITY PRIOR TO TURN ON OF THE CURB BOX.

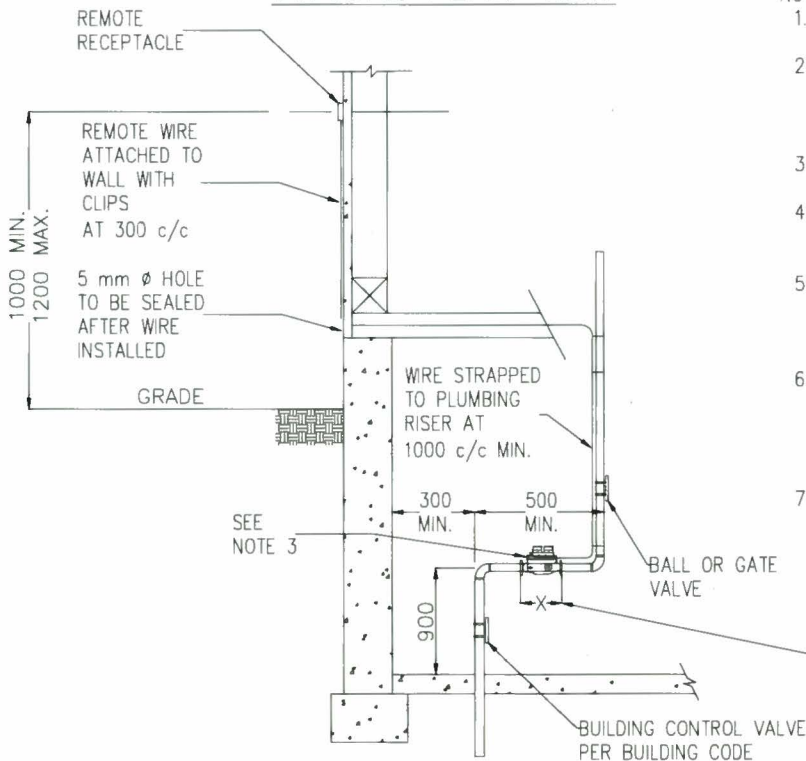

SECTION A-A

DIM 'X'

METER SIZE	X (mm)	X (in)
5/8" x 3/4"	324	12.75
3/4" x 3/4"	357	14.00
0'-1"	407	16.00

ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN



DRAWING NAME:
TYPICAL WATER METER & REMOTE
RECEPTACLE INSTALLATION
15 mm TO 25 mm

SCALE: NTS
REV: 0
DATE: NOVEMBER 2013

APPROVED BY:
[Signature]
DIRECTOR OF ENGINEERING
DWG. NO. MW 31